
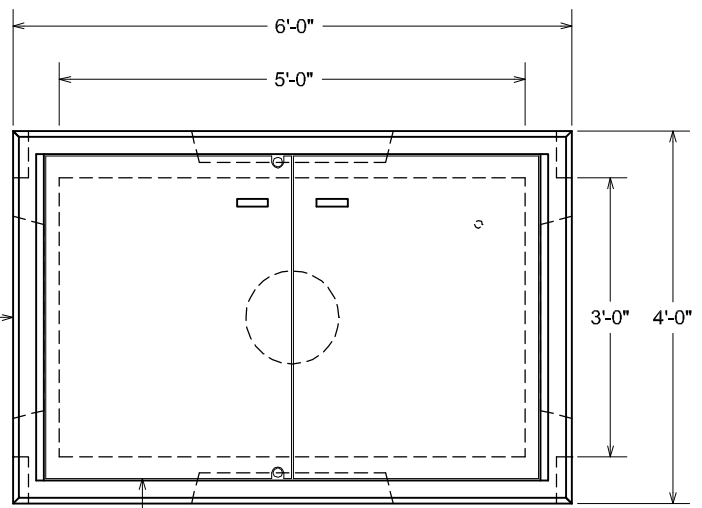


PRECAST CONCRETE

SPLICE BOX

3'-0" WIDE X 5'-0" LONG X 3'-6" HIGH INSIDE DIMENSIONS

VCP ITEM #SB305035

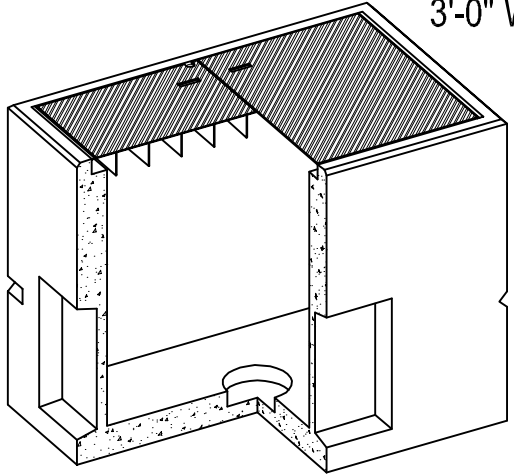

24"x24"x4" DEEP CONDUIT
KNOCKOUTS AT FLOOR LEVEL,
CENTERED IN WIDTH OF EACH
WALL, TYP. OF 4

GALVANIZED STEEL FRAME WITH HINGED 1/4" STEEL
DIAMOND PLATE COVERS WITH DROP HANDLES
SUITABLE FOR OCCASIONAL H-20 LOADINGS
(NOT DESIGNED FOR HIGH DENSITY TRAFFIC)
SPRING ASSISTED COVER WITH STAND, COVERS
BOLT CLOSED WITH TWO 1/2" BOLTS


PLAN VIEW

ENTIRE TOP PERIMETER
EDGE IS CHAMFERED

PROVIDED WITH LIFT NOTCHES
FOR HANDLING, TYP. OF 4

SECTION VIEW

24"x24"x4" DEEP CONDUIT
KNOCKOUTS AT FLOOR LEVEL,
CENTERED IN WIDTH OF EACH
WALL, TYP. OF 4

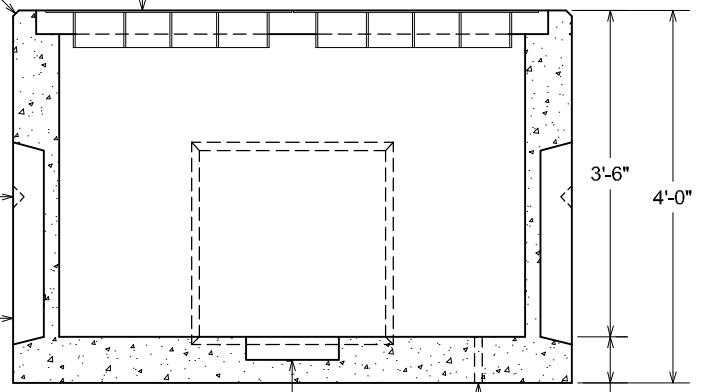

NOTES:

- CONCRETE: 4000 P.S.I. MINIMUM
- REINFORCING: GRADE 60 MINIMUM
- WALLS & FLOOR TO BE 6" THICK
- SUITABLE FOR OCCASIONAL AASHTO HS-20-44 LOADINGS
WHEN PLACED ON MATERIAL CAPABLE OF SUPPORTING
THE LOADINGS

12" DIAMETER X 3" DEEP SUMP
RECESS IN CENTER OF FLOOR

UNIT WEIGHS APPROXIMATELY 6,000 LBS.

1" PVC SLEEVE CAST IN FOR GROUND ROD, 6"
OFF EACH INSIDE WALL OF VAULT

ACTUAL DIMENSIONS OF CONCRETE PRODUCTS MAY VARY SLIGHTLY

DRAWING NOT TO SCALE



3X5X5-6 SPLICE BOX.DWG
DATE CREATED: 11/04
UPDATED: 12/08

12650 Tucson Street • Henderson, Colorado 80640 • 303-659-3747, Fax 303-659-1333
 2671 South Greeley Hwy • Cheyenne, Wyoming 82007 • 307-634-0695, Fax 307-634-0694
 10021 Amarillo Blvd East • Amarillo, Texas 79108 • 806-374-3747, Fax 806-335-3717